



AHU 01
PREDEHŘEV

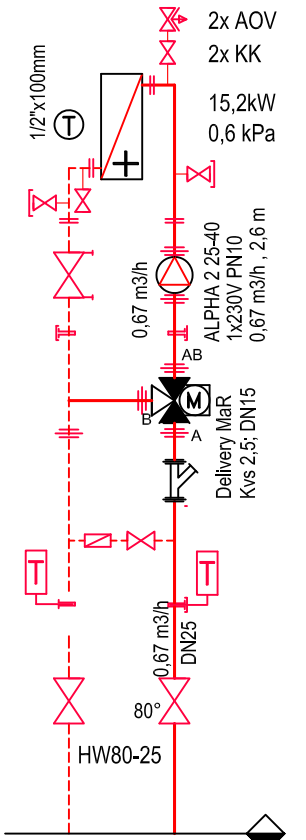


DEVIDIN LINE OF DELIVERY
PLACE CONNECTION
REQUIRED PRESSURE 30kPa

AHU 01
CHLADIČ

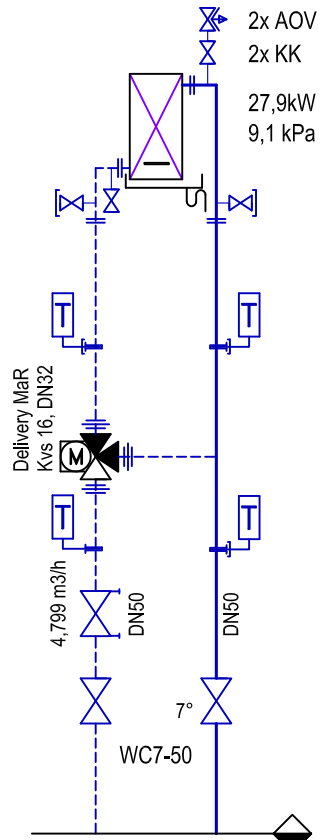


DEVIDIN LINE OF DELIVERY
PLACE CONNECTION
REQUIRED PRESSURE 50kPa

AHU 01
DOHŘEV

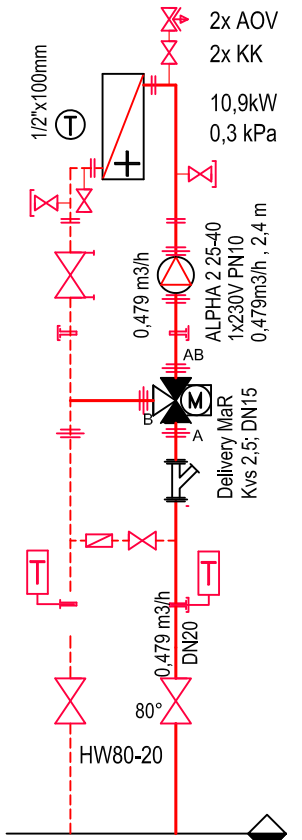


DEVIDIN LINE OF DELIVERY
PLACE CONNECTION
REQUIRED PRESSURE 30kPa

AHU 02
PREDEHŘEV

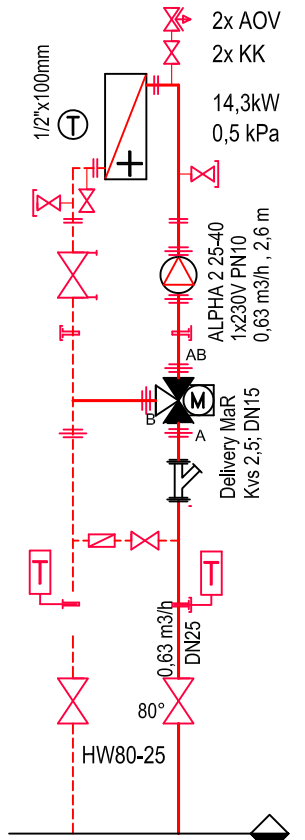


DEVIDIN LINE OF DELIVERY
PLACE CONNECTION
REQUIRED PRESSURE 30kPa

AHU 02
CHLADIČ

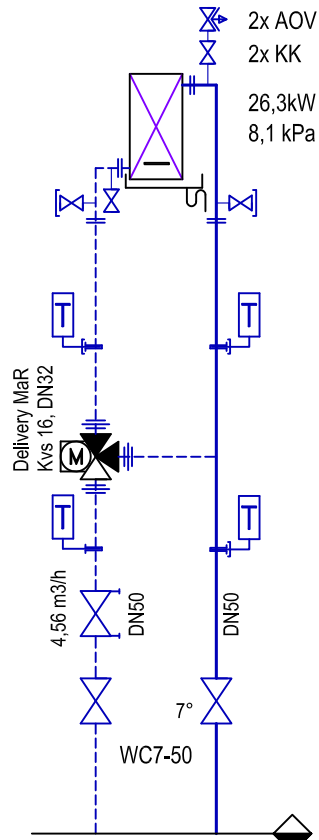


DEVIDIN LINE OF DELIVERY
PLACE CONNECTION
REQUIRED PRESSURE 50kPa

AHU 02
DOHŘEV

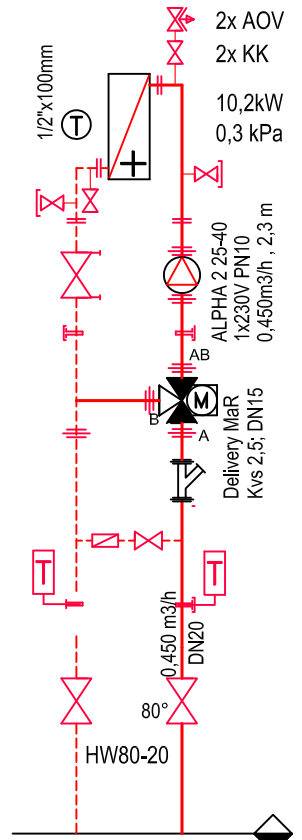


DEVIDIN LINE OF DELIVERY
PLACE CONNECTION
REQUIRED PRESSURE 30kPa

AHU 03
PREDEHŘEV

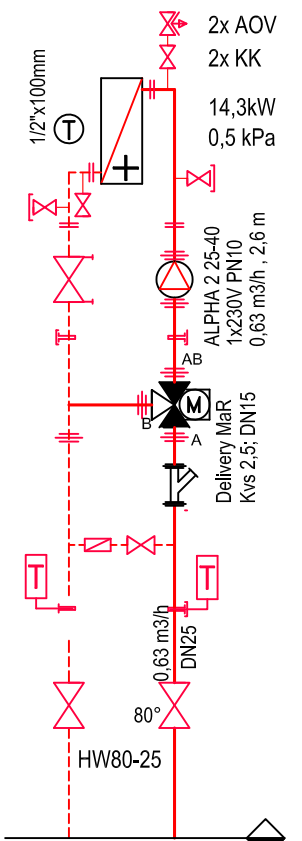


DEVIDIN LINE OF DELIVERY
PLACE CONNECTION
REQUIRED PRESSURE 30kPa

AHU 03
CHLADIČ

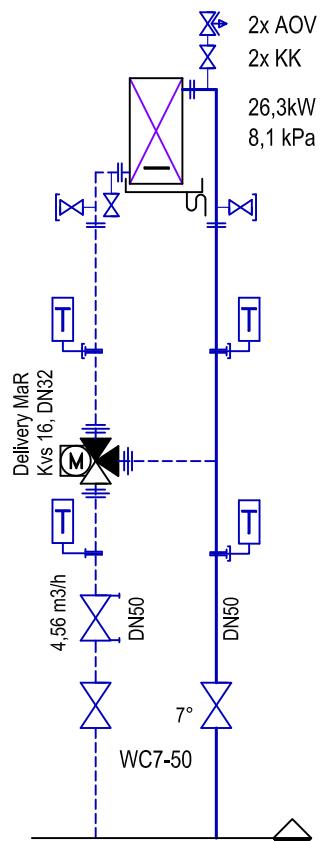


DEVIDIN LINE OF DELIVERY
PLACE CONNECTION
REQUIRED PRESSURE 50kPa

AHU 03
DOHŘEV

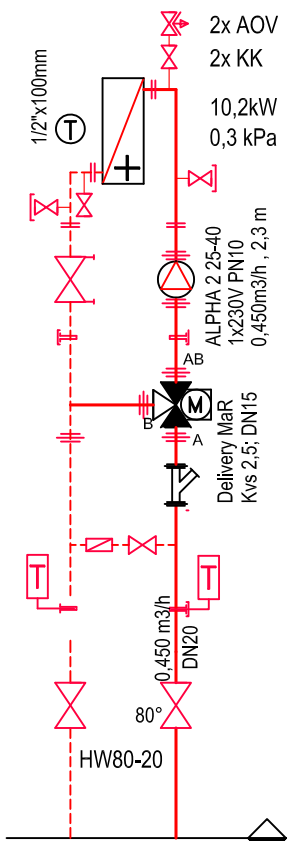


DEVIDIN LINE OF DELIVERY
PLACE CONNECTION
REQUIRED PRESSURE 30kPa

AHU 04
PREDEHŘEV

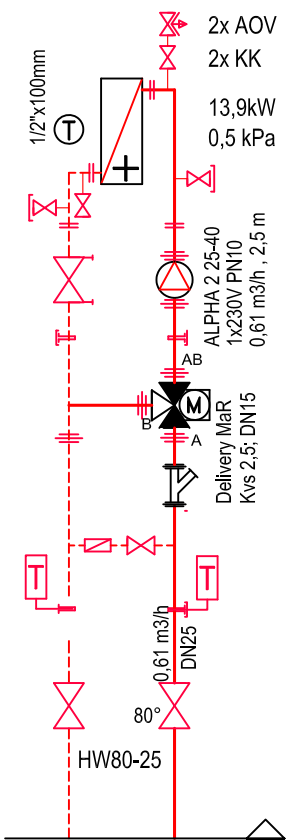


DEVIDIN LINE OF DELIVERY
PLACE CONNECTION
REQUIRED PRESSURE 30kPa

AHU 04
CHLADIČ

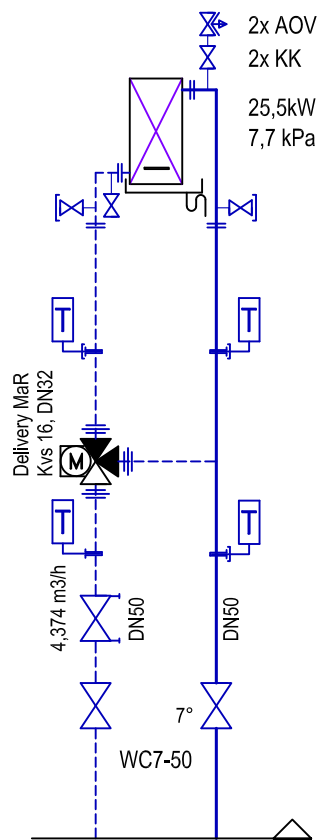


DEVIDIN LINE OF DELIVERY
PLACE CONNECTION
REQUIRED PRESSURE 50kPa

AHU 04
DOHŘEV

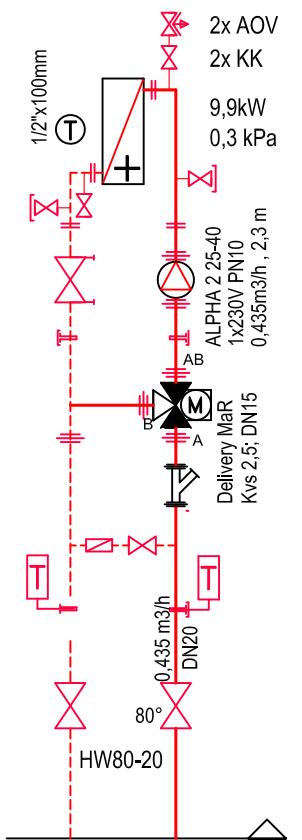


DEVIDIN LINE OF DELIVERY
PLACE CONNECTION
REQUIRED PRESSURE 30kPa

AHU 05
PREDEHŘEV

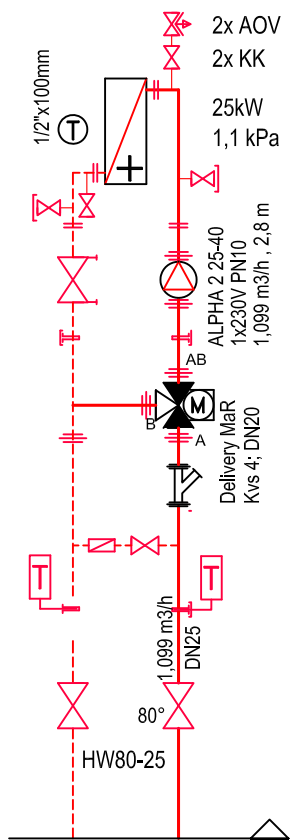


DEVIDIN LINE OF DELIVERY
PLACE CONNECTION
REQUIRED PRESSURE 30kPa

AHU 05
CHLADIČ

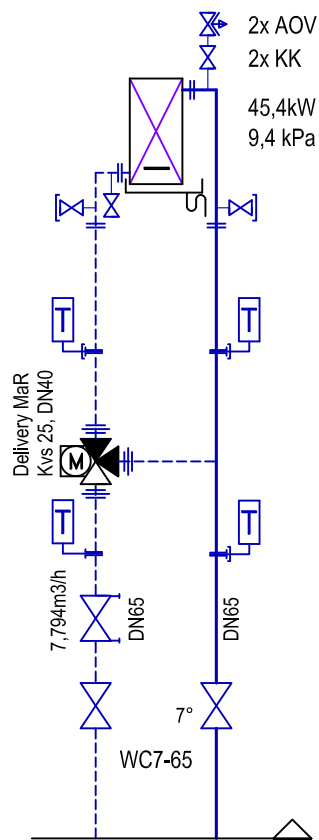

DEVIDIN LINE OF DELIVERY
PLACE CONNECTION
REQUIRED PRESSURE 50kPa

AHU 05
DOHŘEV

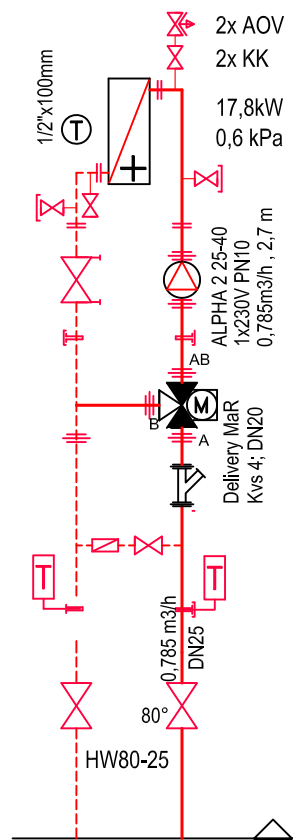

DEVIDIN LINE OF DELIVERY
PLACE CONNECTION
REQUIRED PRESSURE 30kPa

LEGENDA			
	Pump Čerpadlo		Safety valve Pojistný ventil
	Shut off valve Uzavírací ventil		3-way valve Třícest.reg.ventil
	Hand regulating valve ruč. regul. ventil		2-way valve Doucest.reg.ventil
	Strainer Filtr		Actuator Servopohon
			Pressure sensor Senzor tlaku
			One way valve Zpětný ventil
			Thermometer Teploměr
			Pressure gauge Tlakoměr
			Pressure control con. Adaptér tlaku
			Temp. sensor Senzor teploty

Vypracoval:		Projektant:	Schválal:	Vypracovala firma:	
Jakub Truxa		Jakub Truxa	Ing. Milan Štříla	WEISS TECHNIK Praha spol. s r. o.	
Objednatel:		Místo stavby:		Náhodská 224 ČZ: 193 00 Praha 9 tel.: +420 286 019 640 fax: +420 286 019 650 e-mail: firma@weisstechnik.cz	
Sdružení zdravotnické zařízení Kmov		I.P. Pavlova 9, 794 01 KRNOV		Stupeň:	
Modernizace operačních sálů		SO 03 úprava zařízení vzduchotechniky		Datum:	
PID schema uzlů ÚT a CHV VZT PID Scheme Connection point heating and cooling		Umištění v objektu:		Číslo zakázky:	
Obsah výkresu:		Měřítko:		60, 2301.21	
				RL 2301.09	
				Index změn:	